

# Solar production prediction based on non linear meteo source adaptation

Mariam Barque, Luc Dufour, Dominique Genoud, Arnaud Zufferey<sup>1</sup>  
Bruno Ladevie and Jean-Jacques Beziau<sup>2</sup>

<sup>1</sup> Institute of Information Systems, University of Applied Sciences Western Switzerland (HES-SO), Sierre, Switzerland

<sup>2</sup> UMR CNRS 5302, Mines Albi, France

Email: (mariam.barque, luc.dufour, dominique.genoud, arnaud.zufferey)@hevs.ch,  
(bruno.ladevie and beziau)@mines-albi.fr

**Abstract**—This work presents a data-intensive solution to predict Photovoltaïque energy (PV) production. PV and other renewable sources have widely spread in recent years. Although those sources provide an environmentally-friendly solution, their integration is a real challenge in terms of power management as it depends on meteorological conditions. The ability to predict those variable sources considering meteorological uncertainty plays a key role in the management of the energy supply needs and reserves. This paper presents an easy-to-use methodology to predict PV production using time series analyses and sampling algorithms. The aim is to provide a forecasting model to set the day-ahead grid electricity need. This information useful for power dispatching plans and grid charge control. The main novelties of our approach is to provide an easy implemented and flexible solution that combines classification algorithms to predict the PV plant efficiency considering weather conditions and nonlinear regression to predict weather forecasted errors in order to improve prediction results. The results are based on the data collected in the Techno-plex microgrid in Sierre (Switzerland) described further in the paper. The best experimental results have been obtained using hourly historical weather measures (radiation and temperature) and PV production as training inputs and weather forecasted parameters as prediction inputs. Considering a 10 month dataset and despite the presence of 17 missing days, we achieve a Percentage Mean Absolute Deviation (PMAD) of 20% in August and 21% in September. Better results can be obtained with a larger dataset but as more historical data were not available, other months have not been tested.

**Keywords**—Solar production prediction; PV forecast; Data intelligence analysis; Microgrid; Advanced Metering Infrastructure; Energy information management; KNIME;

## I. INTRODUCTION

PV is the fastest-growing energy technology since 2002 with an average increase of 48% [1]. The majority plants are grid-connected systems and a high penetration of PV (like in the case of islands) raises issues for the grid-operators. Subsequently, forecasting the power output of the PV plant is necessary to assure the grid stability.

A large amount of research studies in the domain lay emphasis on predicting solar radiation which is a key data to improve the results. Neural networks are widely used to this purpose and manage to reach a MAPE around 7% on monthly and day-ahead solar radiation forecast [1].

We can cite the example of A. Mellit, a reference author in the subject who achieve a MAPE less than 6% for day-ahead solar radiation in Algeria [2]. Regression trees are not widely used but show a MAPE of 33% for PV production prediction [3]. Some weather providers have also developed solar production forecast solutions like Meteoblue who reaches an average annual MAPE of 28% in Europe using a deterministic approach [6].

Since it is essential for grid operators to analyze and adapt forecast results according to their experience, flexible and user-friendly approaches are preferred. A PV plant can be modeled as a system that converts the suns radiation with a given efficiency. This efficiency is highly related to the solar radiation slope and cells temperature. Therefore, at a fixed temperature and slope, the power produced grows close linear to the global radiation. As such, our approach focuses on analyzing and forecasting this efficiency with statistical tools easy to understand and to use. The method we propose can be used at different levels:

At a mid-term level to anticipate and optimize energy production and make the appropriate choices of investments through energy markets. At a short-term level, grid operators should be able to schedule the day-ahead needs in order to manage the stability of the grid and control the reserve capacity.

According to experts in Computational intelligence, a single algorithm may not be successful in resolving all problems. Most methods described above use neural networks and a few of them use regression trees. Combining models is recommended as ensemble of heterogeneous models leads to a decrease of the ensemble variance as the errors of the individual models have small correlations [4]. We propose, in this paper, to combine decision trees and non linear regression. Contrary to most studies, we do not forecast solar radiation but simply correct the forecasted data given by meteorological enterprises using time series analysis on historical predictions. Our methodology presents two stages. As a first stage, the historical data are used to predict the conversion efficiency of the solar panels and as a second stage, solar radiation forecast is used to predict

the total PV plant production. The paper is organized as follows: In Section I the information system test bed and the data set used are presented. Section II describes the methodology. In Section IV, the results are described and analyzed. Finally we conclude and discuss future directions of research in Section V.

## II. EXPERIMENTAL SETTING

### A. Techno-Pôles microgrid implementation

In energy distribution, new metering solutions have been proposed, based on the idea that exploiting properly data on power generation, distribution and consumption, a substantial increase in efficiency is achievable [6]. The Internet of Things aims at facilitating the communications of such systems. In particular, smart metering is one of the initial and more extended use cases for the Internet of Things [7]. Several solution have been deployed with ZigBee [8], [9] [10], and ZigBee-IP [11]. In addition, Wireless Smart Utility Network (WI-SUN) is also extended with new IoT-related technologies such as IEEE 802.11g (subGhz) [12] and offers plenty of new opportunities to monitor the energy consumption at different levels, i.e. overall consumption and also the independent consumption from specific devices.

Techno-Pôles microgrid is contextualized in the I-BAT Swiss Project 4. This project is a convergence of expertises in several areas of energy management. The objective was to build a modular and intelligent information system capable of regulating futures sub-networks of the power supply grid. It results in the development of two microgrids at the Techno-pôle in Sierre able to measure and collect energy production and consumption each second. The data are displayed in real-time through: <http://www.technopole-vert.ch>. An Advanced Metering Infrastructure (AMI) based on the Internet of Things (IoT) has been implemented in the Techno-Pôle testbed. This deployment provides energy-related parameters such as the overall building load curves and a wireless network of IoT-based smart meters to measure and control appliances.

The Techno-Pôle of Sierre, the sunniest city in Switzerland has a 203 kWp PV plant that represents 1200 m<sup>2</sup> of the roof surface. A weather station have been recently installed in 2015 and will provide more accurate weather data for the microgrids energy management. The site gathers 500 people working for 50 companies including private service providers as well as research institutes like HES-SO which carried out the microgrid project. The building has a restaurant, a fitness room and also multiple classrooms and labs. All of the occupants have signed an agreement offering full access to their consumption for research purposes. The microgrid can also operate as an energy storage management demonstrator as batteries of 25 kWh with a remote control of charge/discharge have been installed. PV electricity production becomes a key information as an input of the optimization of such systems.

In detail, metering infrastructures provide low frequency

parameters (load curves from the photovoltaic plant provided by ELKO, and the grid consumption provided by Sierre-energy) and high frequency parameters (devices measures from the Ecowizz Zigbee smart meters). The information system contains the elements necessary for the storage of data via NO-SQL as the data is formatted in JSON.

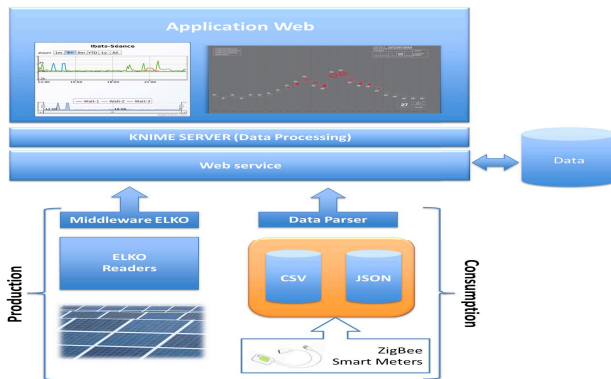


Fig. 1. I-BAT information system architecture based No-SQL databases

### B. Data set description

HOURLY FROM 01.01.2014 TO 10.03.2014		
Weather forecast	Weather real measures	Production real measures
- Irradiation (W/m <sup>2</sup> )	- Irradiation (W/m <sup>2</sup> )	- Power (kW)
- Temperature (°C)	- Temperature (°C)	

Fig. 2. Dataset description

All data are aggregated hourly and available from 01.01.2014 to 10.03.2014. In addition to historical PV production measures, the dataset contains historical real measures and forecast values of temperature and radiation. The forecasted weather values are a one day-ahead prediction in 2014. It is important to note that all weather data are available for Sion which is at 15 km of our production site in Sierre. Actually most of weather stations in Sierre only provide precipitations measures. 17 day missing values which are deleted are due to the system maintenance. PV power production values range from 0 to a maximum of 171 kW with an average power of 32 kW per day (including night). Weather forecasted data shows a total Percentage Mean Absolute Deviation (PMAD) of 26% on radiation prediction and 7% on temperature prediction. 80% (01.01.2014 to 10.03.2014) of the dataset is used for training and 20% for prediction tests (08.16.2014 to 03-10-2014).

## III. METHODOLOGY

In this section, the training model and the error model are presented(cf.Fig3).

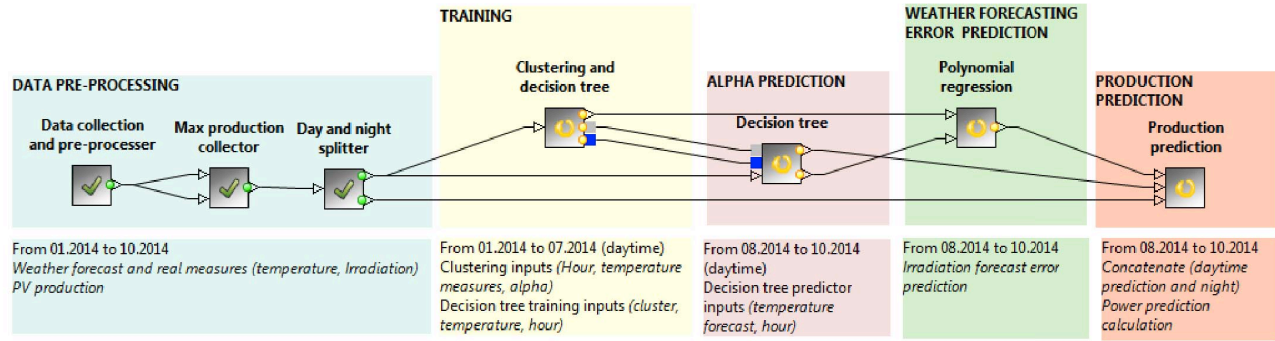


Fig. 3. Steps of the methodology implemented in KNIME

### A. Data pre-processing

This step aims at collecting and pre-processing data. The data collected are described in the previous section. The max production collector goal is to calculate a maximum PV production per day that will enable us to correct overestimated power prediction values. The ideal maximum value should correspond to the sunniest possible conditions for this day. More weather parameters on a larger period are needed to estimate this ideal value. We assume in our approach that it is the hourly maximum production value of the week before the day to predict. The day and night splitter uses daily sunrise and sunset information in order to split the dataset. As night power production is close to zero, only hours between sunset and sunrise will be predicted for each day. Those hours range from 6 AM to 9 PM in our dataset.

### B. Training and prediction

It is important to note here that only the alpha ratio is predicted. We remind here that alpha is the power production divided by the solar radiation measures. This calculation enables us to have a normalized dataset for prediction. Another approach could be to calculate per hour the maximum production for each day (obtained from the best possible radiation on a clear day) and consider the percentage of this maximum produced for each day in the training test and then predict it given weather condition for the test set. In our case, the aim is to estimate the 24 values of alpha that will enable to easily calculate the day production knowing the 24 radiation values forecasted for this day. As noted in the previous section, only daytime hours are predicted, night alpha values are assumed null. As a PV plant efficiency depends on two key parameters that are radiation inclination (assuming cells slope is constant) and cells temperature, the training inputs will be the hour of day and the ambient temperature. The wind speed can also affect cells efficiency as it influences the cells temperature but this data will not be considered in our results as the parameter is not collected by weather stations in Sierre. Snow height is also a key parameter to avoid huge errors in winter due to the presence of snow on the PV cells surface. As our prediction focuses on August and September, precipitation data will not be taken into account.

There are two stages in the training step: The first is to find clusters on alpha regarding hour and temperature values with an Expectation-Maximization (EM) algorithm. As such, the clusters identified depend on the hour and the temperature. This analysis of alpha values is a key step as it enables us to understand how this ratio depends on hour and temperature through Gaussian distributions. As described in the picture below, clusters and real temperature (T) values will then be the inputs of the decision tree learner. The decision tree predictor will return the cluster prediction using hour of day and temperature forecast values as inputs.

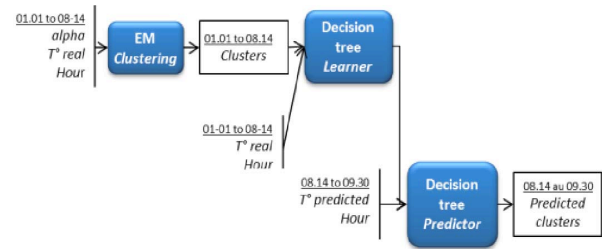


Fig. 4. Description algorithms inputs and outputs

### C. Weather forecast error prediction

As mentioned in the abstract and introduction weather parameters are not predicted in our study. To be representative of most of grid operators, we use forecasted values from national weather services. Nevertheless, the analysis of historical forecasted measures of radiation and real measures of radiation shows a predictable error. Actually the sunnier the hour, the more underestimated the forecasted radiation is. A polynomial regression on radiation forecast errors enables us to go from 16% to 5% of PMAD on radiation forecast errors for the test set (20% of the dataset).

### D. Power prediction

According to alpha definition, the predicted power for each year is given by the formula below: The decision tree output is the predicted cluster. The predicted alpha value is

$$PW_{predicted} = ALPHA_{predicted} \times I_{corrected\ forecast}$$

taken as the clusters mean value. The max power production estimated in the data collecting and processing step is used as a final stage to erase overestimated production prediction. The results are given in the following section.

## IV. RESULTS

### A. Clustering and decision tree results

Alpha values are divided into 6 clusters based on the training dataset.

Cluster	0	1	2	3	4	5
Instance	7%	13%	8%	43%	22%	7%
Mean	0.22	0.14	0.2	0.18	0.17	0.20
stdev	0.30	0.04	0.12	0.05	0.02	0.10

TABLE I. ALPHA CLUSTERING RESULTS

The classification accuracy of the predicted cluster on the test dataset is 88%. The less accurate classified cluster is the 4th with an accuracy of 50% while other clusters have an accuracy of more than 88%. Cluster 4 covers 11 AM to 1 PM which generally corresponds to the sunniest hours of the day. These hours also have the highest radiation forecast errors.

### B. Prediction performance description

Month	MPPROD	MAE	RMSE	PMAD	MAPE	STDEV
	kW	kW	kW	%	%	kW
08	38	7.8	18.3	20	28	16.4
09	32	7.0	13.9	21	26	12.1

TABLE II. FULL METHODOLOGY RESULTS

Month	MPPROD	MAE	RMSE	PMAD	MAPE	STDEV
	kW	kW	kW	%	%	kW
08	38	5.4	9.8	14	23	8
09	32	5.7	11.6	18	34	10

TABLE III. RESULTS ASSUMING PERFECT RADIATION FORECAST

Month	MPPROD	MAE	RMSE	PMAD	MAPE	STDEV
	kW	kW	kW	%	%	kW
08	38	9.5	19.4	24	22	17.0
09	32	9.0	16.4	28	34	13.7

TABLE IV. RESULTS WITHOUT RADIATION ERROR FORECAST PREDICTION

The results are given for 3 scenarios. Scenario A shows the results of the full methodology described in the previous section. Scenario B shows the production assuming a perfect radiation forecast (forecasted radiation equals to real radiation). The aim is to analyze errors that are only due to alpha prediction. Scenario C shows the production prediction using the basic forecasted radiation. The aim is to see the impact of radiation forecast correction on results.

The first column MPPROD is the average production per day (24 hours) given as a reference for a better understanding of the Mean Absolute Error (MAE) and the Root Mean Square Error (RMSE). The STDEV criteria is the

standard deviation of errors. For solar power prediction, the MAE gives a better understanding of prediction errors (7.8 kW in August and 7 kW in September). Actually the hourly electricity cost on markets is fixed per kW and does not depend on the percentage of the energy to buy to the total production. For the percentage error criteria, the Percent Mean Absolute Deviation (PMAD) is preferred instead of the Mean Absolute Percentage Error (MAPE) for solar power prediction. The PMAD is 20% for August and 21% for September. Scenario A compared to scenario B shows that in August, (resp September) 6% (resp 3%) of the PMAD error is due to radiation prediction errors. Therefore, the power prediction error due to alpha prediction is 14% (resp. 18%) for August (resp. September). The third part of the table shows the impact of radiation forecast correction on the results. It enables us to save respectively 4% (resp. 7%) of errors in August (resp. Sept) which represents approximately 2 kW per day.

### C. Results Analysis

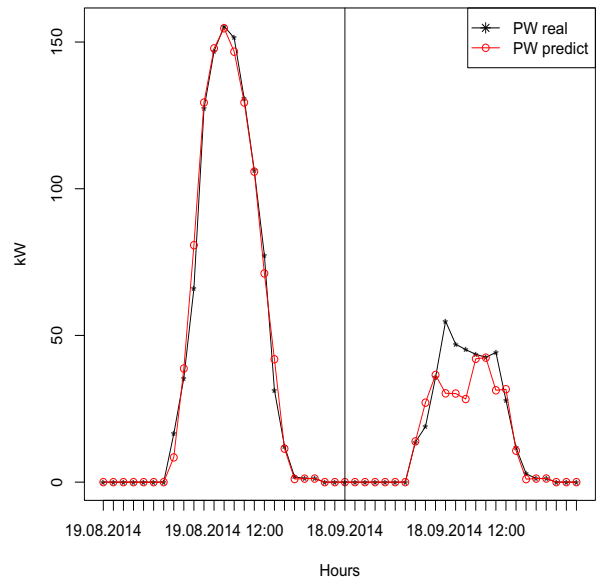


Fig. 5. Example of days with the smallest MAE error for two different days (08.19.2014 and 09.18.2014)

The average PMAD for the two days are respectively 5% and 26% and the MAE related is 1 and 2 kW. The high PMAD value for the second day is due to a lower production. This gives a typical example why MAE and RMSE values give a better understanding of prediction errors. As shown in the graph, the prediction fits well with the real power production. The second day on the graph shows that low values of production can also be well predicted. The errors on alpha prediction are respectively 9% and 15%. The first day represents an ideal sunny day when solar radiation is easier to predict. The percentage of sun duration compared to the maximal sun duration possible for the locality is 80% and the cloud cover

parameter indicates a clear day. For the second day, the sun duration ratio is 10% and the cloud cover parameter indicates a cloudy day. However the prediction fits also the real power well, as weather forecast is accurate for this day.

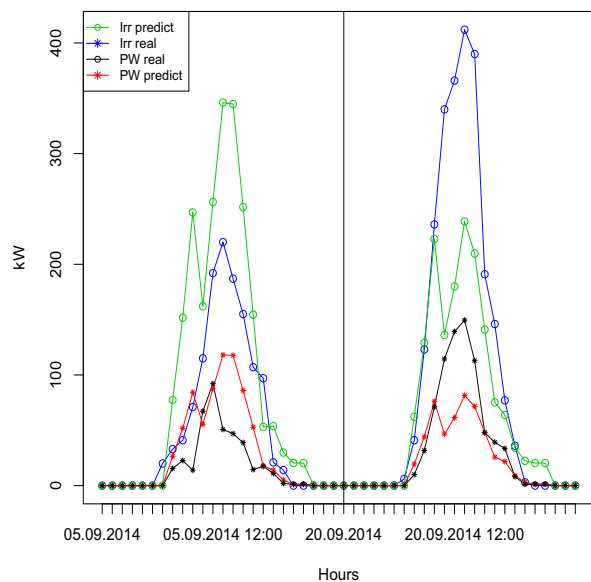


Fig. 6. Example of days the highest MAE error for two different days (09.05.2014 and 09.20.2014)

The MAE of these days are respectively 14 and 12 kW on an average production of 16 and 31 kW which leads to a PMAD of 90 resp. 40%. The graph shows sudden variations of radiation which is typical for cloudy and windy days. Actually, most of the highest MAE errors occur on cloudy days of low sunshine duration. The cloud cover is 10% and 50% for the two days represented in the graph. These instable weather conditions are more difficult to predict. As the graph shows, the evolution of the predicted power follows the one of forecasted data so that high variance in radiation forecast are reflected in the production forecast. The first day, the error is due to both wrong radiation and alpha forecast with PMAD of 40% and 60% respectively whereas radiation forecast is more responsible for the second day error as its PMAD is 48% and alpha prediction PMAD is 1%. Moreover, results show that the average error per hour is higher in sunny hours. According to the results, the highest MAE hours are 11 AM to 2 PM with an average of 18 kW whereas the MAE has an average of 8 kW for the other predicted hours. Actually this error trend is also observed in radiation forecast data.

## V. CONCLUSIONS

The prediction work in our approach focuses on the PV energy conversion ratio from sun radiation. Using an EM clustering algorithm and decision trees on a dataset

from January 2014 to October 2014, the PV efficiency is estimated with an average PMAD of 16% for August and September. The forecasted radiation collected is corrected with a polynomial regression so that the related power prediction have an average PMAD of 20% instead of 26%. Results errors are higher in the sunniest hours. At 11 AM, 12, 1 and 2 PM the MAE is more than two times higher than the other hours predicted (18 kW vs 8 kW). In a sunny and clear day, the production is easier to estimate. It becomes an issue on cloudy and windy days when the global radiation is subject to more variations. The results can be improved if the maximum possible production per day is given as an input. A larger dataset and more weather parameters should help to estimate the maximum production and improve the results. Moreover, a prediction per hour should also improve the results. It would enable us to focus the prediction work on critical hours where other algorithms like nonlinear regression or SVM should be helpful for a better accuracy of alpha prediction.

## VI. ACKNOWLEDGEMENTS

This research was undertaken as part of the I-BAT and ELF4U (Electricity load forecasting for utilities) projects and have been funded by Information system institute ,The Ark Energy and the eEnergy Center (Projects No. 712-07, 714-10).

## REFERENCES

- [1] M. Cococcioni, E. DAndrea, B. Lazzarini, One day ahead forecasting of energy production in solar photovoltaic installations: An empirical study, *Intelligent Decision Technologies* 6 , 2012
- [2] A. Melli, M. Benghanem, S. A. Kalogirou. An adaptive wavelet-network model for forecasting daily total solar-radiation. *Applied Energy*, vol. 83, no. 7, p. 705-722, 2006.
- [3] F. Nomiya, J. Asai, J. Murata, A study on Global Solar Radiation Forecasting Using Weather Forecast Data, *IEEE*, 2011
- [4] R. Hossain, M. B. M. Shawkat, Hybrid Prediction Method of Solar Power using Different Computational Intelligence Algorithms, *IEEE*, 2013
- [5] Z. Fan, G. Kalogridis, C. Efthymiou, M. Sooriyabandara, M. Serizawa, J. McGeehan, The new frontier of communications research: smart grid and smart metering. In *Proceedings of the 1st International Conference on Energy-Efficient Computing and Networking*. pp. 115118, ACM.
- [6] Meteoblue, Point Solar Radiation Forecast Controlled Quality, Basel, 2013, <https://content.meteoblue.com/en/products/meteoblue-api/solar>
- [7] S. W. Luan, J. H. Teng, S. Y. Chan, L. C. Hwang, Development of a smart power meter for AMI based on ZigBee communication. In *Power Electronics and Drive Systems, PEDS 2009. International Conference on*. pp. 661-665, IEEE, (2009).
- [8] M. Castro, A. J. Jara, A. F. Skarmeta, (2013), Smart Lighting Solutions for Smart Cities. In *Advanced Information Networking and Applications Workshops (WAINA), 2013 27th International Conference on*. pp. 13741379, IEEE.
- [9] T. Watteyne, L. Doherty, J. Simon, K. Pister, Technical Overview of SmartMesh IP. In *Innovative Mobile and Internet Services in Ubiquitous Computing (IMIS), 2013 Seventh International Conference on*. pp. 547-551, IEEE, 2013
- [10] Z. Shelby, Embedded web services. *Wireless Communications, IEEE*. Vol. 17, no. 6, pp. 52-57, 2010.
- [11] V. C. Gungor, B. Lu, G. P. Hancke, Opportunities and challenges of wireless sensor networks in smart grid. *Industrial Electronics, IEEE Transactions on*. Vol. 57, no. 10, pp. 3557-3564, 2010
- [12] A. Mellit, S. A. Kalogirou, Artificial intelligence techniques for photovoltaic applications: A review. *Progress in Energy and Combustion Science* n1-1, p 52-76, 2008.